


**NOTES:**

1. PLACE AT GRADE BOX AT ONE OF THE THREE LOCATIONS SHOWN. PER DRAWINGS OR PER DIRECTION FROM DISTRICT'S REPRESENTATIVE. FOR ROAD WITHOUT CURB PLACE AT-GRADE CTS BEYOND PAVEMENT OUT OF TRAFFIC LANES BUT WITHIN EASEMENT.
2. USE POST-MOUNTED CTS IN UNDEVELOPED SITES. LACE DIRECTLY OVER PIPE WHERE POSSIBLE, OR AS DIRECTED BY DISTRICT'S REPRESENTATIVE.
3. PROVIDE SAND BEDDING AND BACKFILL IN WIRE TRENCHES. SEE STD SPEC. 02223.
4. WARNING TAPE SHALL BE 6" WIDE, 4 MIL THICK INERT PLASTIC WARNING TAPE PRINTED WITH "CAUTION: CATHODIC PROTECTION CABLE BELOW".
5. USE SIMILAR MOUNTING FOR MULTI-WIRE CTS.

# OLIVENHAIN MUNICIPAL WATER DISTRICT

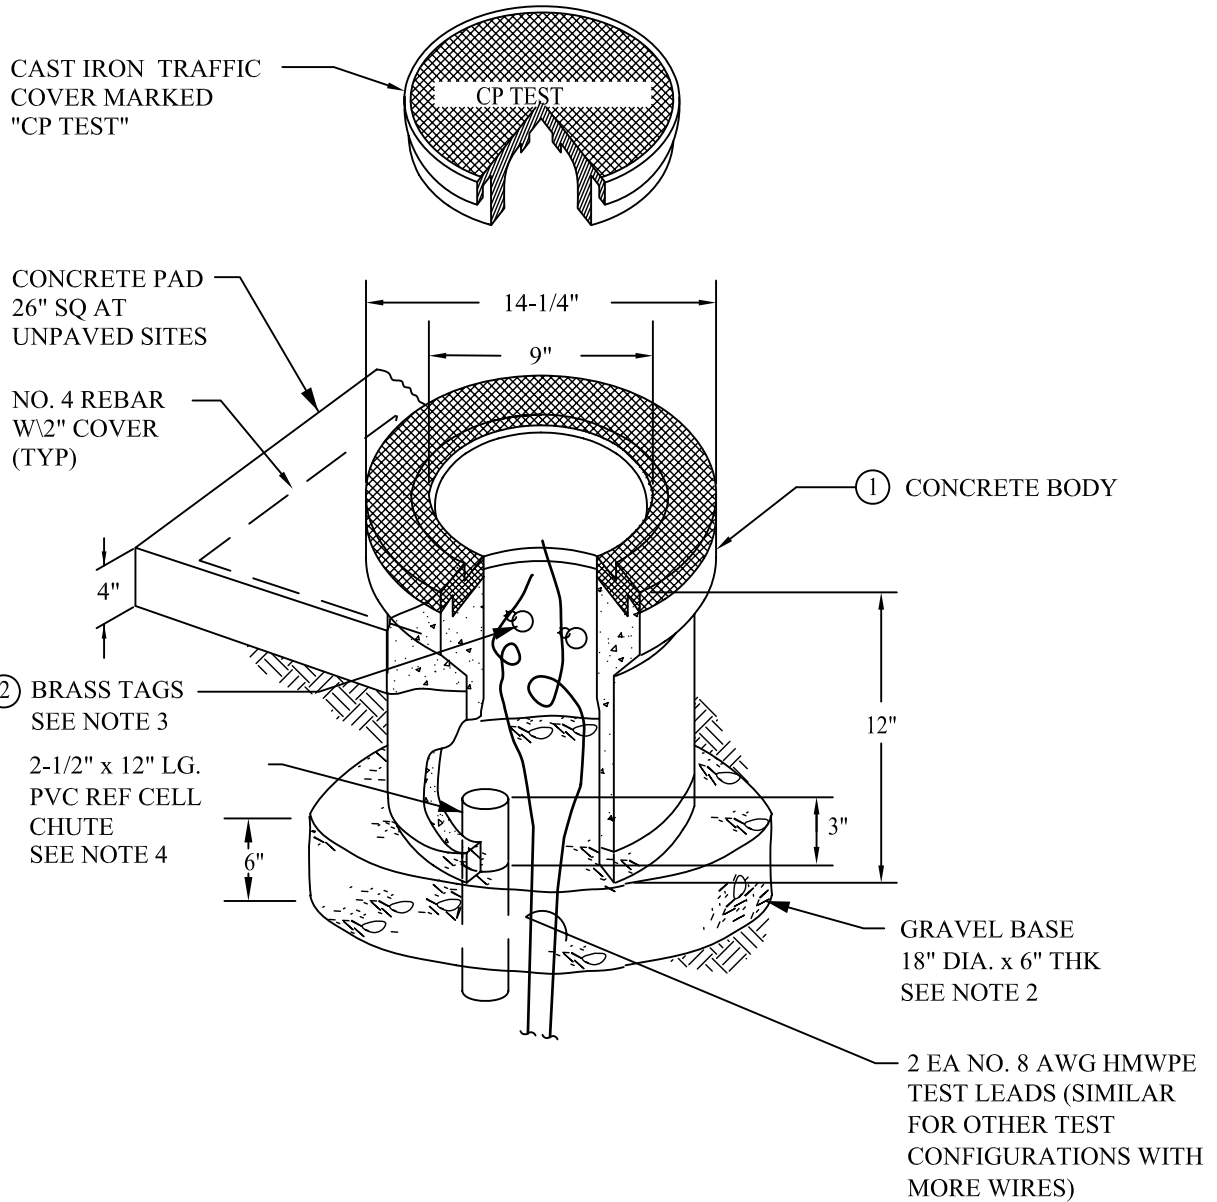

NOTES:

1. ALL WIRES SHALL HAVE 18" MIN. SLACK IN BOX.
2. BOTTOM OF TEST BOX SHALL BE 3/4" GRAVEL BASE/LEACH FIELD.
3. FIRMLY STAMP BRASS TAGS "OMWD, SIZE AND SERVICE" (EXAMPLE: OMWD 24" RW). USE 1/4" HIGH CHARACTERS. SECURELY ATTACH BRASS TAGS TO TEST LEADS WITH BARE NO. 14 COPPER WIRE.
4. FILL PVC REF CELL CHUTE WITH NATIVE SOIL, NOT GRAVEL.

ITEM	DESCRIPTION	SPEC/DWG
1	CHRISTY G5 TRAFFIC VALVE BOX	13110
2	18 GA, 1-1/2" DIA WITH 1/16" OFFSET HOLE	13110

**OLIVENHAIN MUNICIPAL WATER DISTRICT**




AT - GRADE TEST BOX

STD DWG NO.

G-2

JUNE 2008

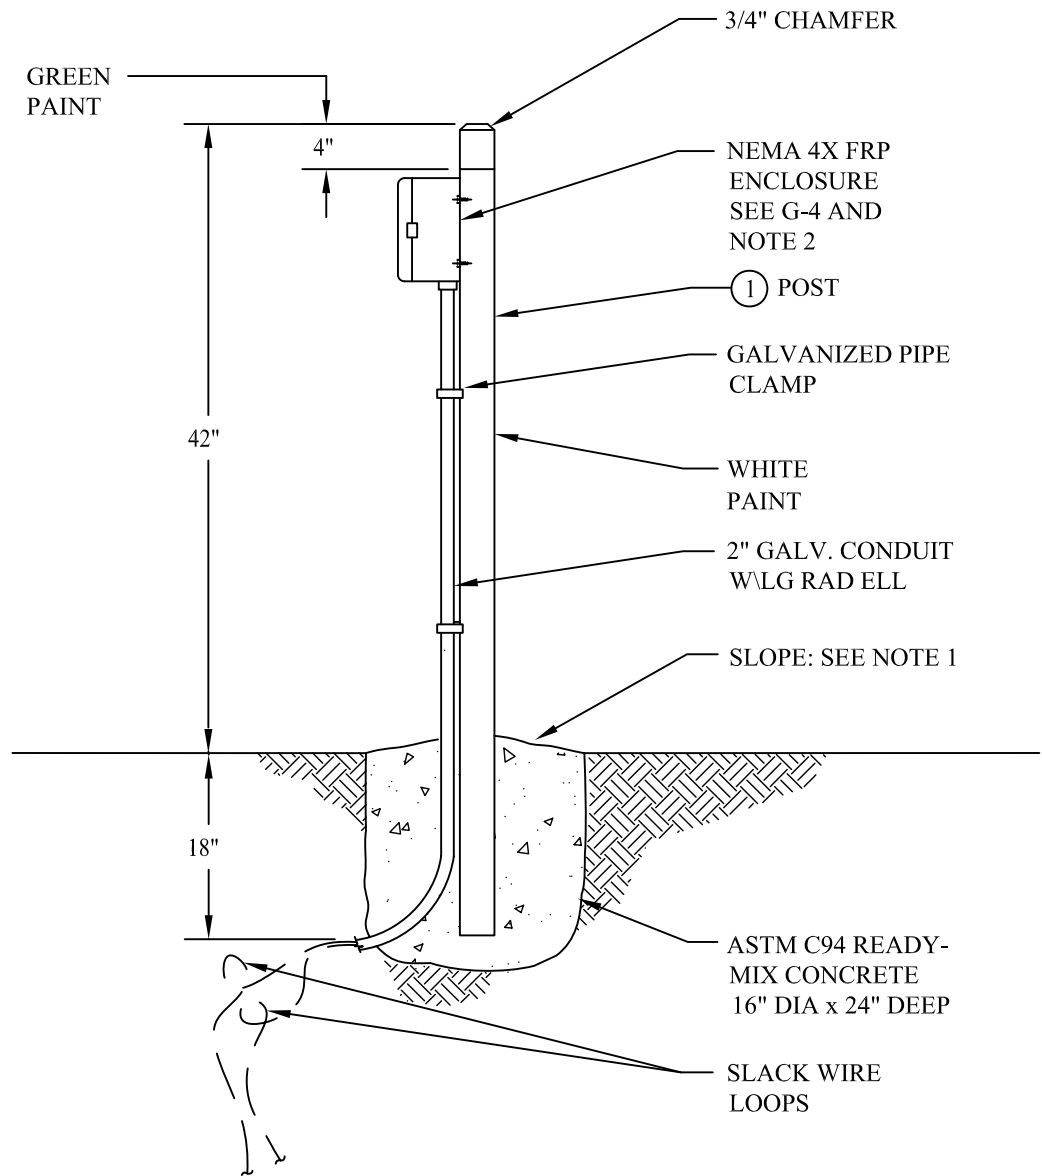

NOTE:

1. SLOPE CONCRETE SLIGHTLY TO PREVENT WATER FROM POOLING NEXT TO POST.
2. ATTACH FRP BOX TO POST WITH 1 1/2 " NO. 10 WOOD SCREWS.


ITEM	DESCRIPTION	SPEC/DWG
1	CONSTRUCTION HEART REDWOOD 4" x 4" x 5' LONG	13110

## OLIVENHAIN MUNICIPAL WATER DISTRICT



POST - MOUNTED TEST BOX

STD DWG NO.  
**G-3**  
 JUNE 2008

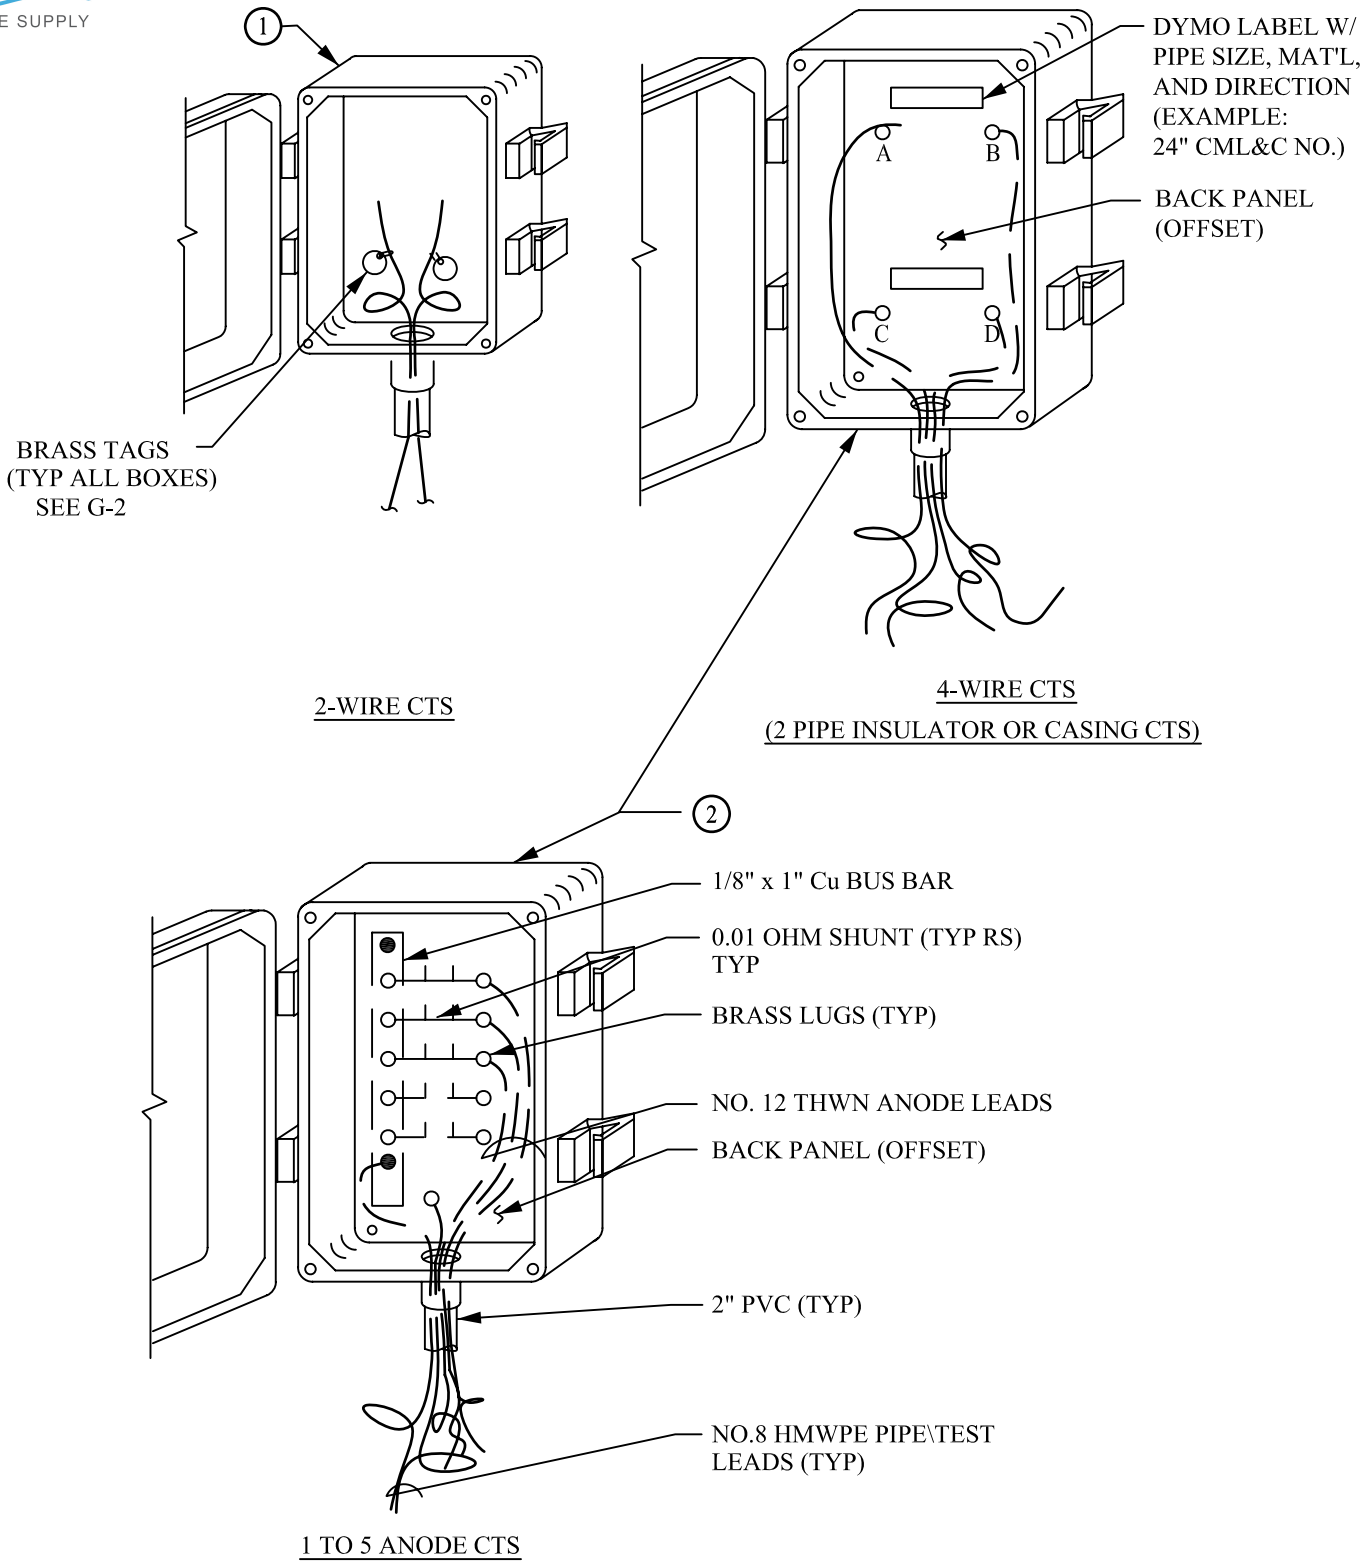

**NOTE:**

1. FIX TO POST WITH 1-1/2" NO. 10 WOOD SCREWS. SEE G-3

ITEM	DESCRIPTION	SPEC/DWG
1	HOFFMAN 4X FRP ENCLOSURE (A-645JFGQRR) 5.5" x 4" x 5"	13110
2	HOFFMAN 4X FRP ENCLOSURE (A-865JFGQRR) W\COMPOSITE PANEL OFFSET W\ PANEL EXTENDER (A-PE100) 7.5" x 6" x 5.25"	13110

## OLIVENHAIN MUNICIPAL WATER DISTRICT





### WIRING IN POST-MOUNTED TEST BOX

STD DWG NO.  
**G-4**  
 JUNE 2008

SEE NOTE 1

ALUMINO THERMIC  
 WELD (TYP)  
 SEE G-13

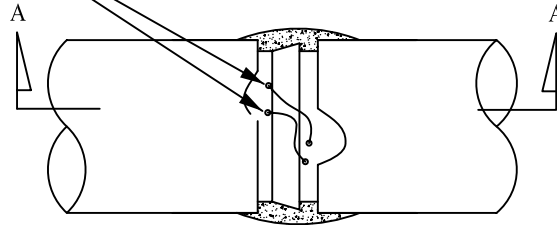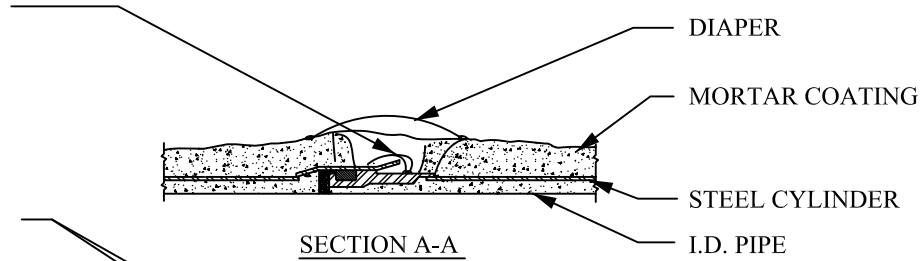


STEEL

MORTAR LINED  
 DIP

POLYETHYLENE  
 ENCASEMENT  
 SEE NOTE 4

B

RUBBER  
 GASKET

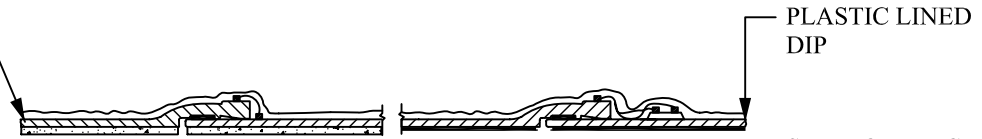

SECTION B-B

STL. BONDING PAD  
 (4-1/2" x 2" x 3/8"  
 THK.) SEE NOTE 2

B

2 EA BOND WIRES  
 SEE NOTE 1

DUCTILE IRON PIPE

NOTES:

1. BOND WIRE SIZE:

<u>PIPE DIA</u>	<u>WIRE SIZE</u>
≥ 18"	NO. 2 AWG HMWPE (OR AS SPECIFIED ON DRAWINGS)
> 18"	NO. 4 AWG HMWPE

BOND WIRES TO BE AS SHORT AS POSSIBLE.

- PADS TO BE INSTALLED ON PLASTIC LINED DIP BY PIPE SUPPLIER BEFORE APPLICATION OF COATING OR LINING. PADS TO BE FULLY SEAL WELDED.
- ALL BONDED PIPE REACHES SHALL BE CONTINUITY TESTED.
- POLYETHYLENE ENCASEMENT SHOWN FOR REFERENCE ONLY. SEE DRAWINGS AND STD SPECS FOR DIP COATING REQUIREMENTS.

**OLIVENHAIN MUNICIPAL WATER DISTRICT**

1 EA NO.6 HMWPE  
 SEE NOTE 2

ALUMINO-THERMIC  
 WELD (TYP).  
 SEE F-13

1-NO.6 HMWPE

2-BOND WIRES  
 SEE NOTE 1

WAX TAPE AND  
 POLYETHYLENE  
 ENCASEMENT  
 SEE NOTE 3

2-BOND WIRES (TYP)  
 SEE NOTE 1

COUPLINGS

3" (TYP) →

1-NO. 6  
 HMWPE (TYP)

WAX TAPE AND  
 POLYETHYLENE  
 ENCASEMENT  
 SEE NOTE 3

2-BOND WIRES  
 (TYP) SEE NOTE 1

ALTERNATE  
 SEE NOTE 2

VALVE

FLANGE

NOTES:

1. BOND WIRE SIZE:

<u>PIPE DIA</u>	<u>WIRE SIZE</u>
≥ 18"	NO. 2 AWG HMWPE
< 18"	NO. 4 AWG HMWPE

2. WIRES CAN BE WELDED DIRECTLY TO PIPE CYLINDER OR FLANGE. JUMPER FROM PIPE TO COUPLING CAN BE BRAZED TO FOLLOWER.
3. WRAP ALL RODS, BOLTS & IRREGULAR SURFACES. PER STD. SPEC SECTIONS 09952 AND 09954.
4. CARE SHALL BE TAKEN WHEN BACKFILLING TRENCH TO PREVENT DAMAGE TO WAX TAPE SYSTEM.

**OLIVENHAIN MUNICIPAL WATER DISTRICT**

INSULATING SLEEVE  
 (FULL WIDTH OF MATED  
 FLANGES)  
 SEE NOTE 1

STEEL NUT  
 (TYP 2 PLS)

STEEL WASHER  
 BOTH ENDS OF STUD

INSULATING WASHER  
 BOTH ENDS OF STUD

STEEL THREADED STUD  
 (SIMILAR FOR BOLTS)

INSULATING GASKET

SEE DETAIL "A"

INSULATING WASHER

STEEL WASHER

GASKET

INSUL WASHER

STL WASHER

STL NUT

DETAIL A

**NOTES:**

1. USE HALF WIDTH SLEEVES AT THREADED FLANGE BOLTS.
2. INSULATING MATERIALS:
  - GASKET - 12" AND GREATER- TYPE "E" FULLFACED PHENOLIC WITH RECTANGULAR NITRILE OR VITON O-RING SEAL. (PSI LINEBACKER OR EQUAL).  
 12" OR LESS - TYPE "E" FULLFACED NEOPRENE FACED PHENOLIC.
  - SLEEVE 1/32-INCH THICK, FULL LENGTH TUBE, LAMINATED G-10 GLASS.
  - WASHER 1/8-INCH THICK LAMINATED G-10 GLASS SHEET.
3. ALIGN FLANGE PROPERLY AND FOLLOW GASKET MANUFACTURER BOLT TIGHTENING SEQUENCE INSTRUCTIONS.
4. DO NOT PAINT OUTER SURFACE OF FLANGE WITH METALLIC PIGMENTED OR CONDUCTIVE PAINTS.
5. TEST MATED FLANGE WITH GAS ELECTRONICS MODEL 601 INSULATION CHECKER (OR EQUIVALENT) PRIOR TO ACCEPTANCE. SEE STD. SPEC. 13110.

**OLIVENHAIN MUNICIPAL WATER DISTRICT**




ABOVE-GRADE  
 INSULATING FLANGE

STD DWG NO.

G-7

JUNE 2008

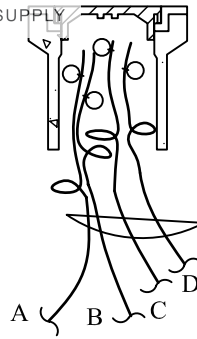


FOR POST-MOUNTED CTS  
 WIRING SEE G-3  
 FOR AT-GRADE BOX LOCATION  
 SEE G-1.

HMWPE TEST WIRES  
 SEE NOTE 3

INSULATING SLEEVE  
 (FULL LENGTH)

INSULATING WASHER  
 BOTH ENDS OF STUD


STEEL NUT & WASHER  
 BOTH ENDS OF STUD



STEEL THREADED STUD  
 (SIMILAR FOR BOLTS)

INSULATING GASKET  
 TYPE 'E'

ALUMINO-THERMIC  
 WELD (TYP)  
 SEE G-13

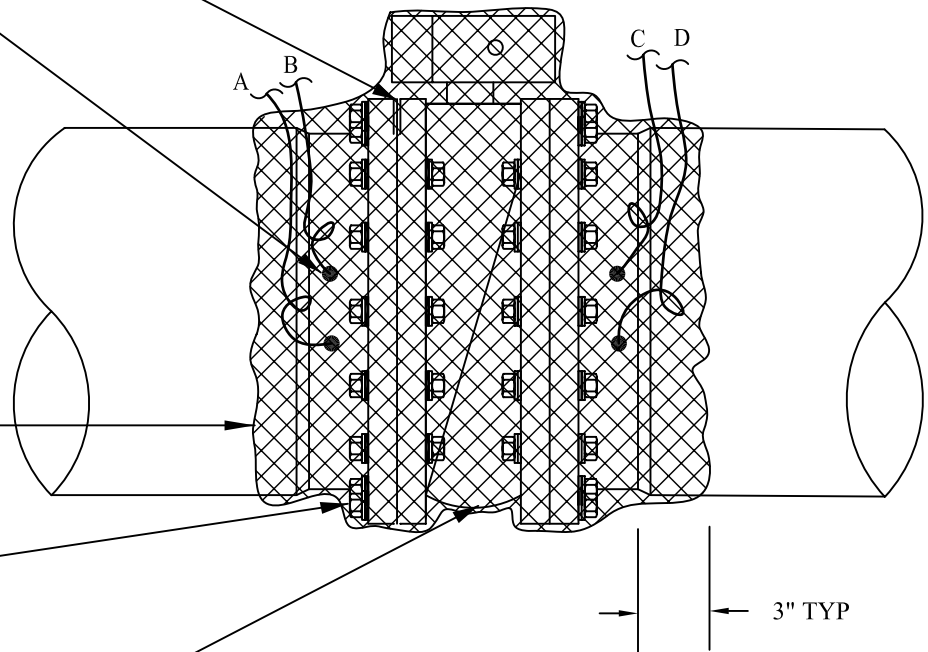

WAX TAPE WRAP AND  
 POLYETHYLENE ENCASEMENT  
 SEE G-6

THREADED BOLT AT  
 BONNET AND BASE  
 SEE NOTE 2

VALVE (SIMILAR FOR  
 FLANGE PAIR WITHOUT  
 VALVE)

NOTES:

1. FOR INSULATING MATERIALS SEE STD DWG G-7.
2. FULL LENGTH INSULATING SLEEVES REQUIRED AT ALL THRU-FLANGE BOLTS OR STUDS. HALF LENGTH SLEEVES REQUIRED AT THREADED BOLT HOLES AT VALVE BONNET AND BASE.
3. UNLESS OTHERWISE INDICATED ON DRAWINGS WIRES A & C ARE NO. 2 HMWPE, WIRE B IS NO. 6 HMWPE, AND WIRE D IS NO. 8 HMWPE.


# OLIVENHAIN MUNICIPAL WATER DISTRICT



WARNING TAPE  
 SEE G-1

AT-GRADE CTS  
 OPTION.  
 SEE G-1 AND G-2.  
 SEE WIRING  
 DIAGRAM BELOW

POST-MOUNTED  
 CTS OPTION.  
 SEE G-3 AND G-4.

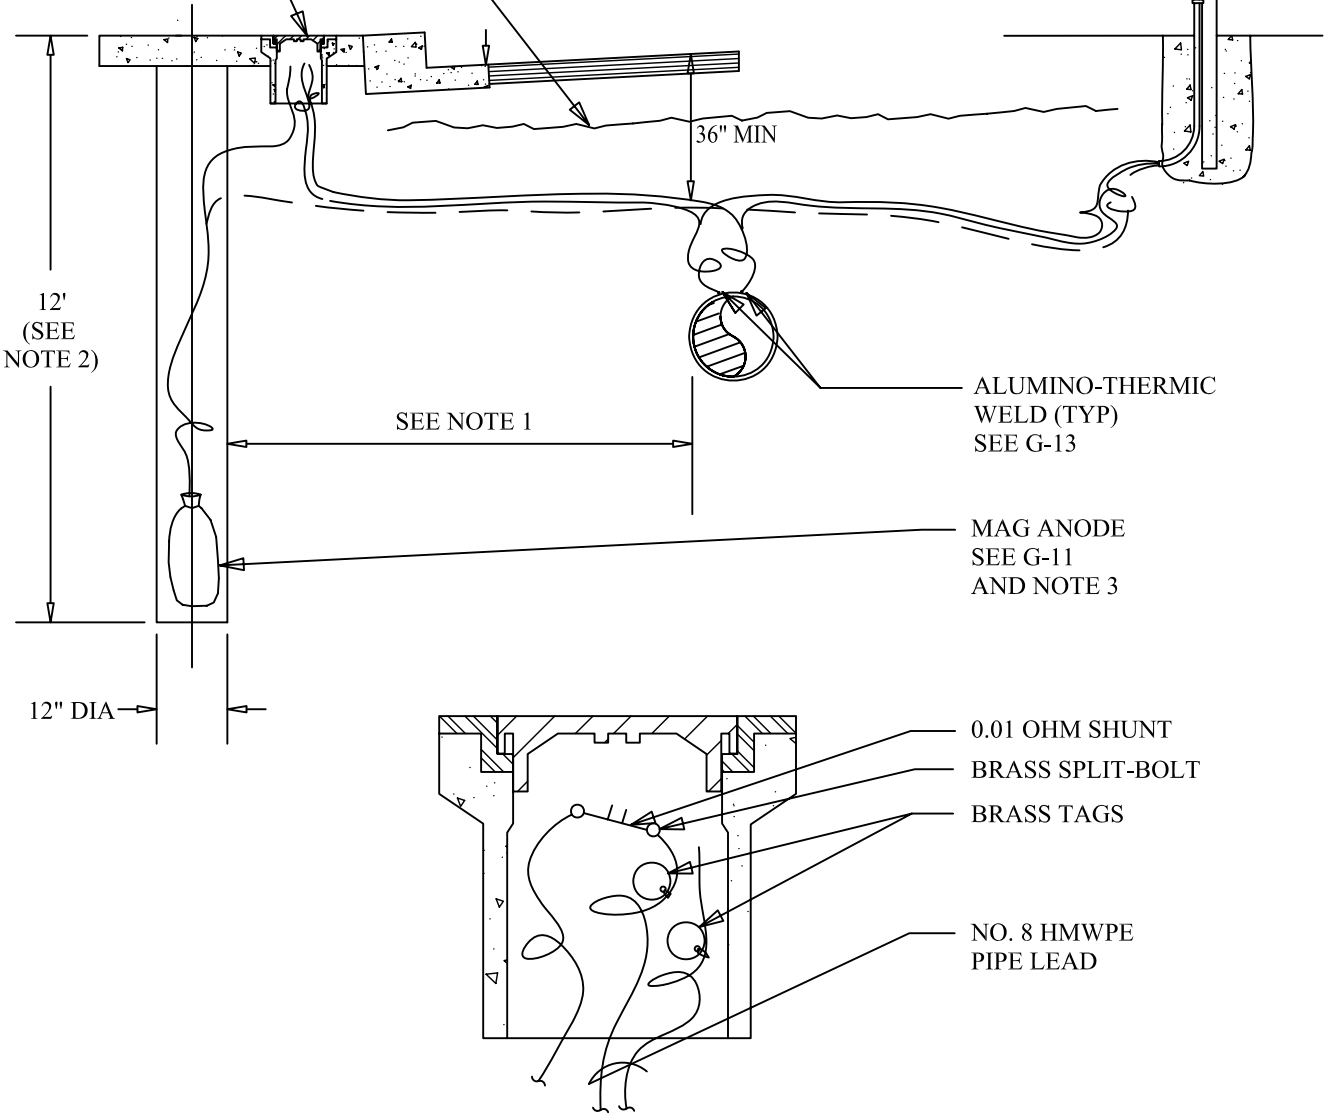

SEE NOTE 1

ALUMINO-THERMIC  
 WELD (TYP)  
 SEE G-13

MAG ANODE  
 SEE G-11  
 AND NOTE 3


0.01 OHM SHUNT  
 BRASS SPLIT-BOLT  
 BRASS TAGS  
 NO. 8 HMWPE  
 PIPE LEAD

AT-GRADE CTS WIRING  
 (SEE G-1 AND G-2)

NOTES:

1. HORIZONTAL ANODE DISTANCE FROM PIPE SHALL BE MAXIMUM ALLOWABLE WITHIN OMWD RIGHT-OF-WAY OR AS INDICATED IN THE DRAWINGS. DO NOT INSTALL ANODE SUCH THAT A FOREIGN METALLIC PIPELINE EXISTS BETWEEN ANODE AND PIPE. MINIMUM OFFSET IS 8' UNLESS OTHERWISE SPECIFIED ON DRAWINGS.
2. DEPTH IS 12' UNLESS OTHERWISE INDICATED ON DRAWINGS.
3. LOCATE ANODE, AND TEST BOX PER DRAWINGS OR DISTRICT REPRESENTATIVES DIRECTION.
4. INSTALL EITHER AT-GRADE CTS OR POST-MOUNTED CTS AS DEFINED ON DRAWINGS.


**OLIVENHAIN MUNICIPAL WATER DISTRICT**

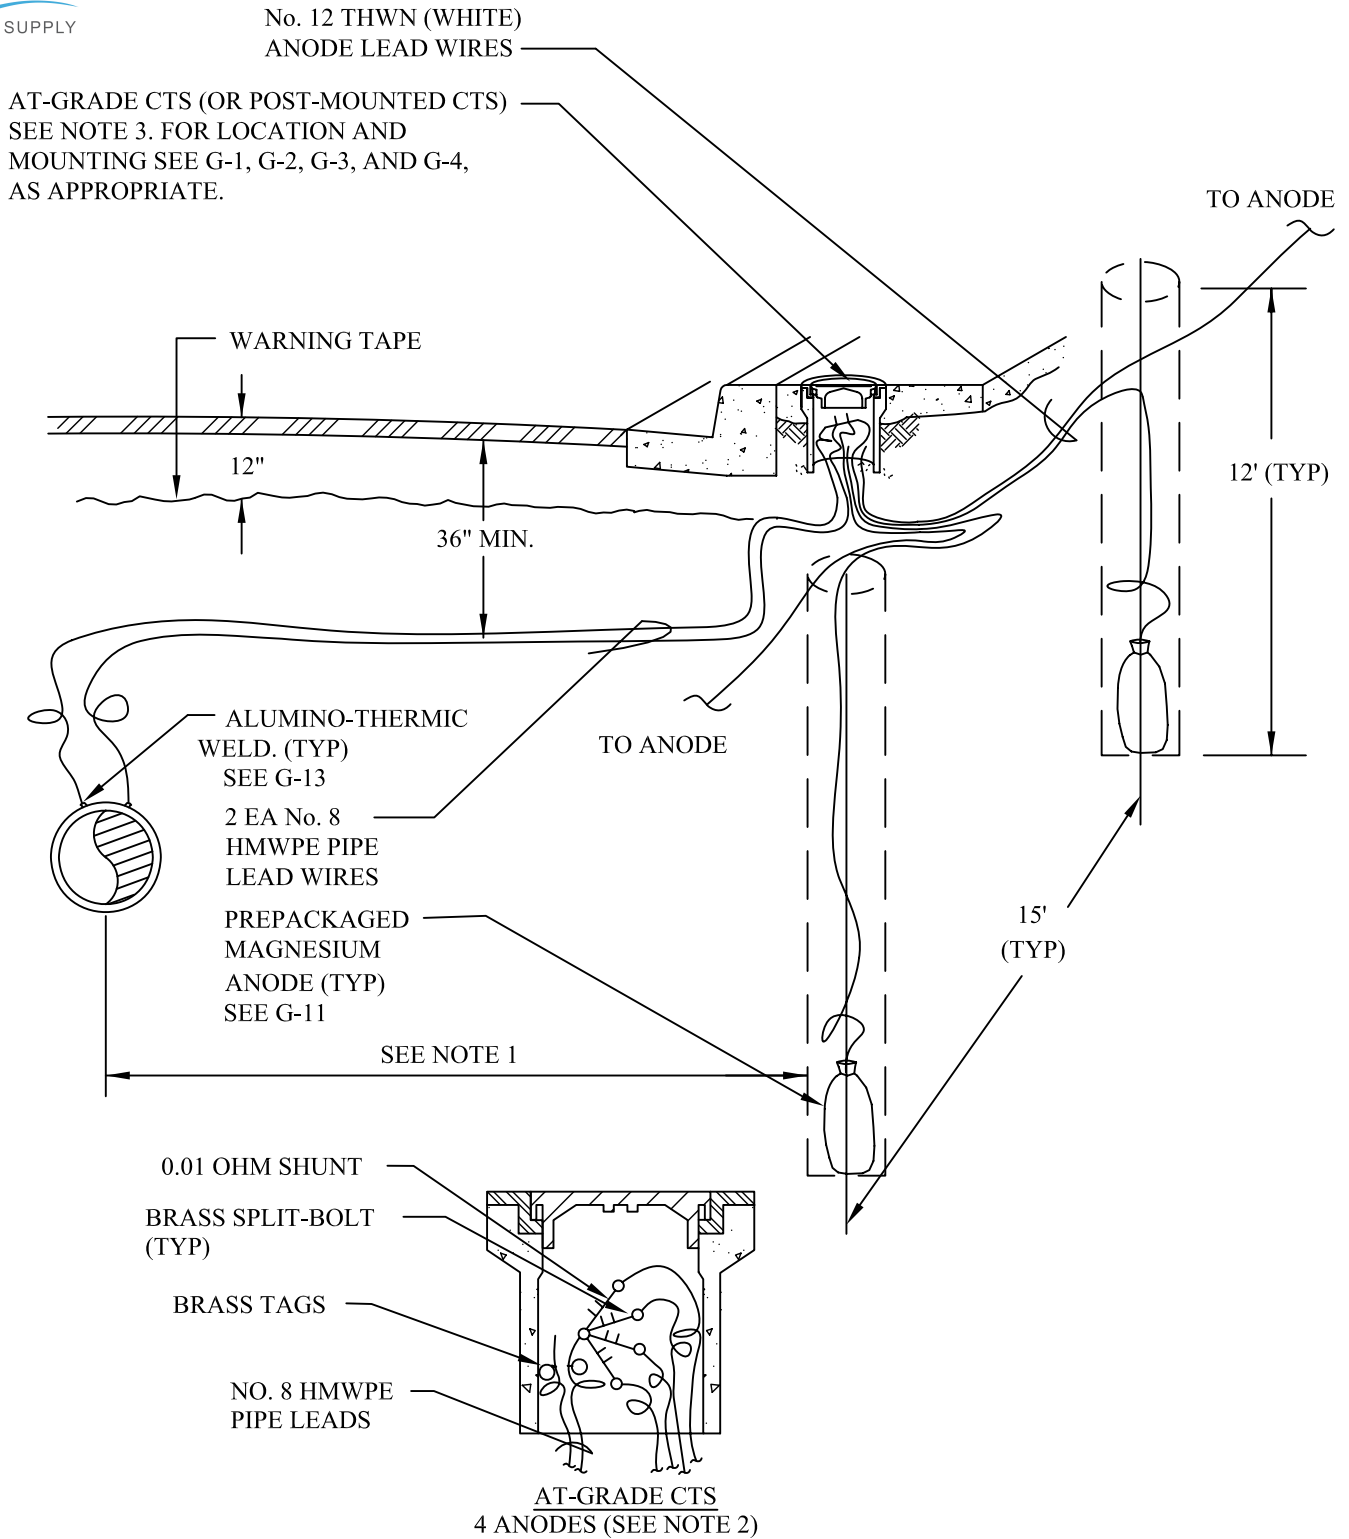

**NOTES:**

1. HORIZONTAL ANODE DISTANCE FROM PIPE SHALL BE MAXIMUM ALLOWABLE WITHIN OMWD RIGHT-OF-WAY OR AS INDICATED IN THE DRAWINGS. DO NOT INSTALL ANODE SUCH THAT A FOREIGN METALLIC PIPELINE EXISTS BETWEEN ANODE AND PIPE. MINIMUM OFFSET IS 8' UNLESS OTHERWISE SPECIFIED ON DRAWINGS.
2. WIRING FOR 4 ANODES SHOWN. USE SIMILAR WIRING FOR 2 TO 5 ANODES
3. INSTALL EITHER AT-GRADE CTS OR POST-MOUNTED CTS AS DEFINED ON DRAWINGS.

**OLIVENHAIN MUNICIPAL WATER DISTRICT**

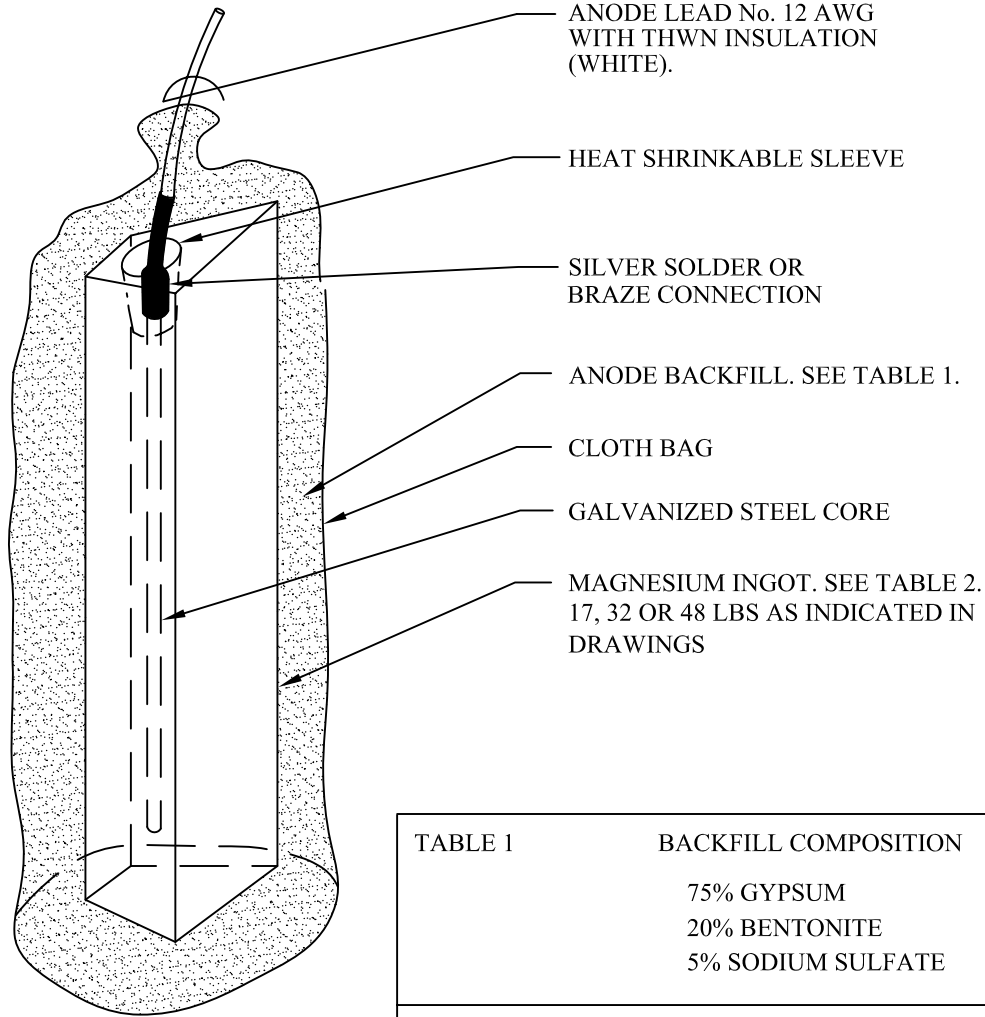

**NOTES:**

1. SEE STD SPEC 13110 FOR ANODE SOAKING AND INSTALLATION REQUIREMENTS.
2. USE HIGH POTENTIAL ANODES UNLESS STANDARD POTENTIAL ANODES ARE REQUIRED ON DRAWINGS.
3. SEE DRAWINGS FOR ANODE WEIGHT.

**TABLE 1**

**BACKFILL COMPOSITION**

75% GYPSUM  
 20% BENTONITE  
 5% SODIUM SULFATE


**TABLE 2**

**MAGNESIUM ANODE ALLOY COMPOSITION  
 HIGH & STANDARD  
 POTENTIALS**

Element	HIGH POTL	STANDARD POTL
	Weight %	Weight %
Al	.01 Max	5.3 to 6.7
Mn	0.05 to 1.3	0.15 to 0.30
Zn	0.002 Max	2.5 to 3.5
Cu	0.02 Max	0.02 Max
Ni	0.001 Max	0.002 Max
Fe	0.025 Max	0.003 Max
Si	0.002 Max	0.10 Max
Other	0.05 each Max and 0.3 Total	0.05 each Max and 0.3 Total
Mg	Max Balance	Max Balance

**OLIVENHAIN MUNICIPAL WATER DISTRICT**

AT-GRADE CTS (OR POST MOUNTED CTS).  
 SEE NOTE 2. FOR LOCATION AND  
 MOUNTING SEE G-1, G-2, G-3, AND  
 G-4, AS APPROPRIATE

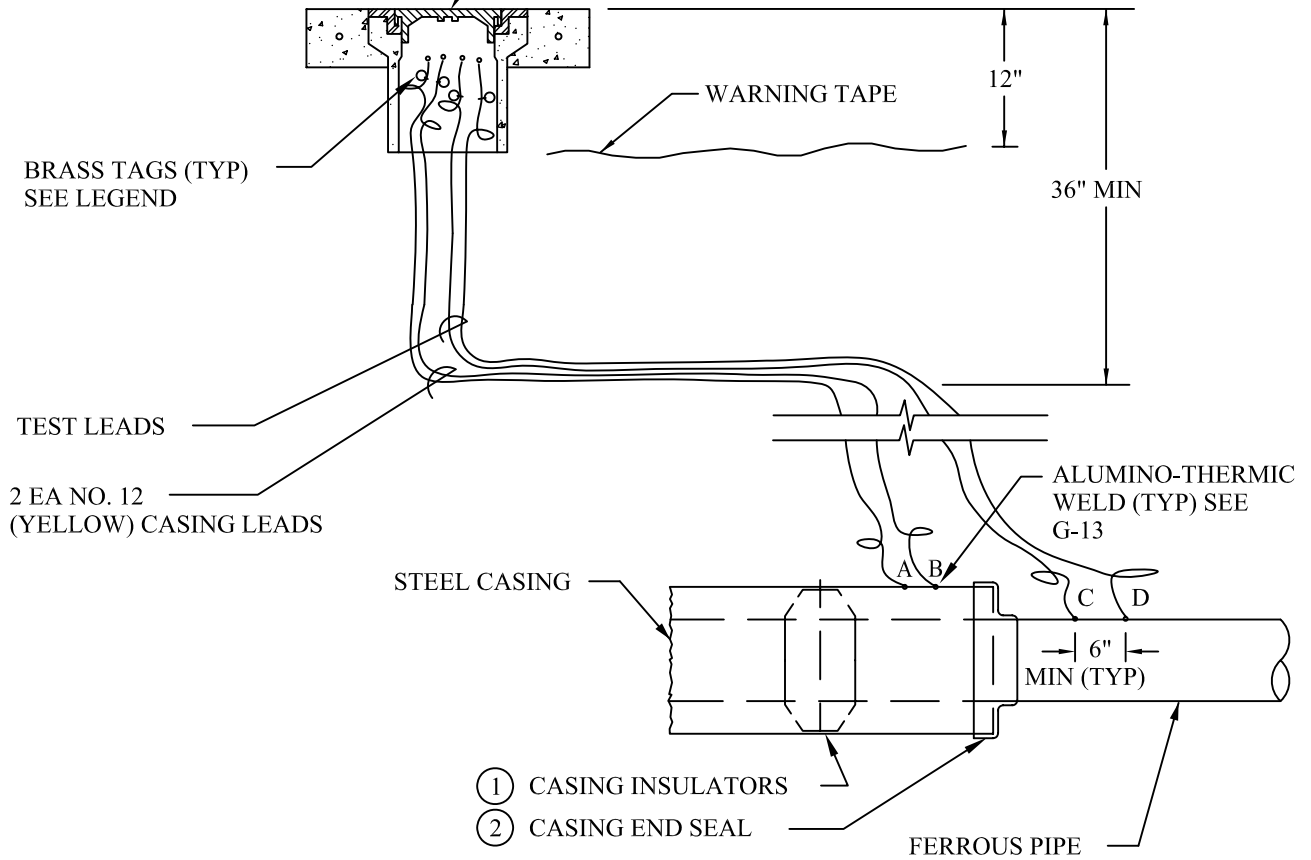

**BRASS TAG LEGEND**

WIRE	SIZE	ID STAMP
A	No. 12 (YEL) THWN	CASING
B	No. 12 (YEL) THWN	CASING
C	No. 8 HMWPE	OMWD, SIZE, SERVICE
D	No. 8 HMWPE	OMWD, SIZE, SERVICE

**NOTE:**

1. PROVIDE ELECTRICAL/METALLIC ISOLATION BETWEEN THE CASING AND THE CARRIER PIPE.
2. INSTALL EITHER AT-GRADE CTS OR POST-MOUNTED CTS AS DEFINED ON DRAWINGS.


ITEM	DESCRIPTION	SPEC/DWG
1	PSI MODEL A12 G-2 OR EQUAL	13110
2	HEAT SHRINK OR MECH LINK TYPE	13110

**OLIVENHAIN MUNICIPAL WATER DISTRICT**




**4 - WIRE TEST STATION  
 FOR PIPE CASING**


**STD DWG NO.  
 G-12  
 JUNE 2008**




**STEP 1**  
 CHIP AWAY MORTAR  
 IF NECESSARY  
 FILE\GRIND SURFACE TO  
 BRIGHT METAL  
 AND CLEAN




**STEP 2**  
 STRIP INSULATION  
 FROM WIRE

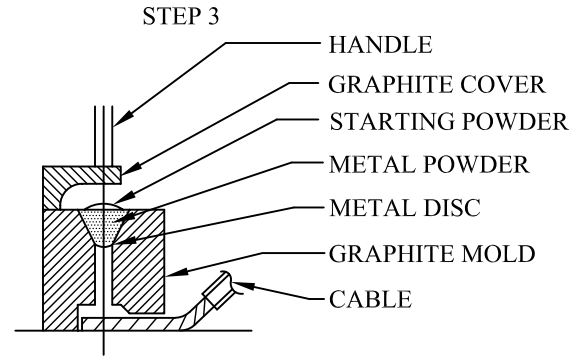


**STEP 3**  
 HOLD WELDER FIRMLY  
 WITH OPENING AWAY  
 FROM OPERATOR,  
 IGNITE STARTING POWDER



**STEP 4**  
 REMOVE SLAG  
 FROM CONNECTION  
 AND TEST  
 SEE NOTE 4



**STEP 5**  
 APPLY 2 COATS PRIMER  
 AND COVER CONNECTION  
 WITH PRE-FORMED WELD  
 CAP



**STEP 6**  
 COAT WITH BITUMINOUS  
 COMPOUND SEE NOTE 3

**NOTES:**

1. WELDER SHOWN IS FOR HORIZONTAL SURFACES; FOR VERTICAL SURFACES SIDE WELDER IS REQUIRED.
2. ATTACH 1 WIRE PER WELD ALL WIRE WELDS SHALL BE 6 INCHES APART, MINIMUM.
3. ALL EXPOSED METAL (STRUCTURE, WIRE, & WELD) SHALL BE COVERED WITH 2 COATS OF PRIMER AND AN ELASTOMERIC WELD CAP, THEN OVER-COATED WITH BITUMINOUS COMPOUND OVERLAPPING PIPE COATING BY 2 INCHES MIN.
4. ALL WELDS SHALL BE TESTED BY STRIKING THE WELD WITH A 2 LB HAMMER WHILE PULLING FIRMLY ON WIRE. ANY WELDS BROKEN OR LOOSENED SHALL BE RE-WELDED AND RE-TESTED. THE SURFACE MUST BE RE-GROUND AND CLEAN BEFORE RE-WELDING. ALL WELD SLAG SHALL BE REMOVED FROM THE WELD.

**OLIVENHAIN MUNICIPAL WATER DISTRICT**