# C900 BLUE



TECHNICAL DATA SUBMITTAL (4" - 12")

#### **CONFORMANCE**

These specifications designate the requirements for manufacturing and installing Vinyltech AWWA C900 PVC Pressure Pipe for potable water (4"-12").

ANSI/AWWA C900 - Polyvinyl Chloride (PVC) Pressure Pipe and Fabricated Fittings, 4" Through 60" (100mm Through 1,500mm)

**AWWA C605** - Underground Installation of Polyvinyl Chloride (PVC) Pressure Pipe and Fittings for Water

**ASTM D1784** - Standard Specification for Rigid Poly (Vinyl Chloride) (PVC) Compounds and Chlorinated Poly (Vinyl Chloride) (CPVC) Compounds

**ASTM D3139** - Standard Specification for Joints for Plastic Pressure Pipes Using Flexible Elastomeric Seals

**ASTM F477** - Standard Specification for Elastomeric Seals (Gaskets) for Joining Plastic Pipe

**NSF/ANSI 61, Annex G** - Drinking Water Systems Components-Health Effects

**FM 1612** - Approval Standard for Polyvinyl Chloride (PVC) Pipe and Fittings for Underground Fire Protection

**UL 1285** - Standard for Pipe and Couplings, Polyvinyl Chloride (PVC), and Oriented Polyvinyl Chloride (PVCO) for Underground Fire Service

#### **PIPE COMPOUND**

The pipe shall be extruded from compounds meeting (PVC 1120) the requirements of Cell Classification 12454, as defined in ASTM D1784, Standard Specification for Rigid Poly (Vinyl Chloride) (PVC) Compounds and Chlorinated Poly (Vinyl Chloride) (CPVC) Compounds. The PVC shall also be listed by the National Sanitation Foundation (NSF) for use in potable water.

#### **PIPE**

Vinyltech pipe shall be manufactured in accordance with AWWA C900.

#### **GASKET JOINT**

The gasket shall be reinforced with a steel band and meet the requirements of ASTM F477. Vinyltech pipe shall have an integral bell end with a locked-in factory installed gasket and shall meet the joint requirements of ASTM D3139.

#### **MARKING**

The pipe shall be marked in accordance with AWWA C900.

#### **QUALITY CONTROL**

Each length of the pipe including the bell shall be hydrostatically tested in accordance with AWWA C900. The pipe shall meet all additional test requirements as described in AWWA C900. Our full-time quality assurance staff continually administers a rigid program of tests to maintain the production of the best pipe products available.

#### **INSTALLATION**

Recommended installation procedures of Vinyltech Corporation are outlined in AWWA C605, Underground Installation of Polyvinyl Chloride (PVC) Pressure Pipe and Fittings for Water. The AWWA Manual M23, PVC Pipe Design and Installation, is also an invaluable resource guide for design and installation.

#### **TAPPING**

The consistent success of tapping PVC pressure pipe is contingent upon the use of proper procedures and equipment. Vinyltech recommends strict compliance with the requirements as specified in AWWA C605.

#### **ASSEMBLING THE PIPE**

Assembly of Vinyltech PVC water pipe is easily accomplished. A depth of entry mark is on each spigot end to serve as a visual check for rapid, accurate joint inspection. **Do not over insert.** 

- Remove any mud, sand, or other foreign matter from the belled and spigot ends of the pipe. Carefully clean the gasket area.
- 2) With a clean applicator (a brush or hand) lubricate the entire surface of the pipe from the spigot end to the depth of entry mark and the contact surface of the gasket with **Vinyltech Brand Lubricant**.
- 3) Brace the bell to avoid disturbing the already installed joints. Align the pipe, insert the spigot into the bell and push.
- 4) Do not insert past the entry mark line.











VINYLTECH • 201 S. 61st Avenue • Phoenix, AZ 85043 • 602 233-0071 • Fax: 602 272-4847 • www.vtpipe.com





# C900 BLUE TECHNICAL DATA SUBMITTAL (4" - 12")




Effective 11/17

## C900 DR 18 Pressure Class 235

NOMINAL SIZE		OUTER	MINIMUM	FEET PER	LIFTS PER	APPROX WEIGHT
(IN)	(mm)	DIAMETER (IN)	WALL (IN)	LIFT	TRUCK	(LB/100')
4	100	4.800	0.267	1020	16	251.6
6	150	6.900	0.383	440	16	521.2
8	200	9.050	0.503	200	20	903.0
10	250	11.100	0.617	240	12	1364.4
12	300	13.200	0.733	60-80	28	1935.8

## C900 DR 14 Pressure Class 305

NOMINAL SIZE		OUTER	MINIMUM	FEET PER	LIFTS PER	APPROX WEIGHT
(IN)	(mm)	DIAMETER (IN)	WALL (IN)	LIFT	TRUCK	(LB/100')
4	100	4.800	0.343	1020	16	317.5
6	150	6.900	0.493	440	16	658.7
8	200	9.050	0.646	200	20	1139.7
10	250	11.100	0.793	240	12	1722.3
12	300	13.200	0.943	60-80	28	2445.5

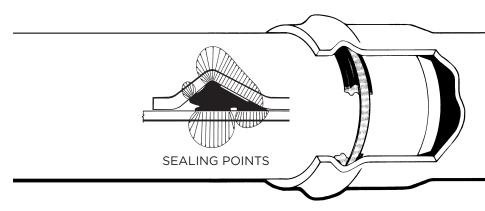

## The Rieber **Sealing System**

The Rieber system provides a proven pipe joint with an excellent track record in the field. It is the fastest growing system in the world because of its many advantages.

- · Factory installed, locked-in gasket
- · The pipe bell forms over the gasket, making a perfect fit
- · Avoids the possibility of installing the wrong gasket
- Reduces installation problems
- · The locked-in gasket eliminates gasket roll-out during joining
- The gasket is molded vs. extruded and spliced
- · Works equally well under pressure or vacuum
- Three sealing points achieved vs. two
- LEAK-PROOF JOINTS
- "THE WORLDS BEST JOINT"



